



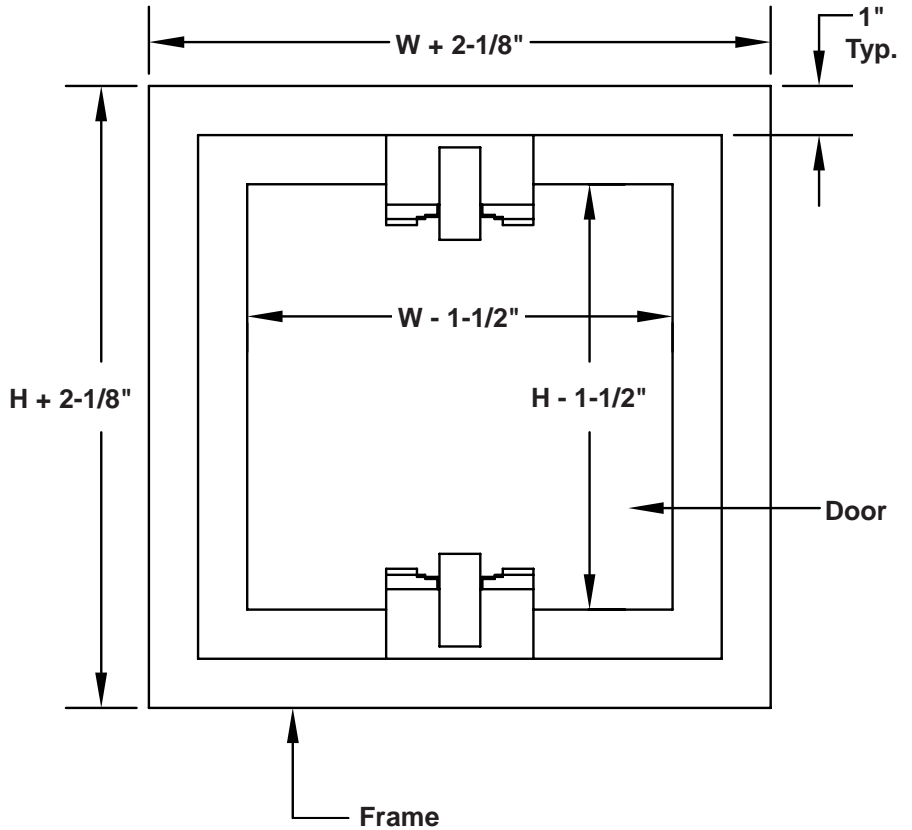

# MODEL ARD

ACCESS DOOR FOR POSITIVE PRESSURE DUCTS  
(Relief On Negative Pressure)  
Standard Construction To 12" S.P.

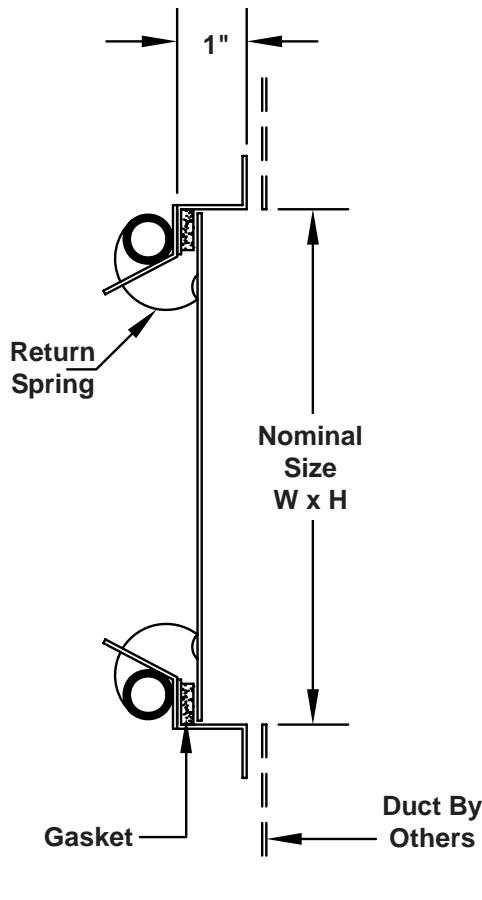

QTY.	DOOR SIZE		No. of Springs
	Width	Height	
	6	10	2
	8	8	2
	10	10	2
	12	12	4
	14	14	4
	18	18	4

## FEATURES:

- Provides access for inspection / resetting of fire dampers.
- 16 gauge galvanized steel construction.
- Positive duct pressure provides seal between door and frame.
- Install on downstream side of dampers in positive pressure duct for negative pressure relief to prevent duct collapse due to accidental closing of fire dampers during system operation.
- Relieves at approximately 1 to 1.5 IWG negative duct pressure when installed in a vertical orientation. Relief pressure is **NOT** adjustable. Not intended for installation on top of duct.
- Auto door return.
- Available options include Plexiglas window or double wall insulated door.

To maintain KEES' policy of continuous product improvement, we reserve the right to change prices, specifications, ratings or dimensions without notice or obligation.

Project		Location	
Engineer			
Architect		Dwg. No.	SD-ARD
Contractor		Date	06/07

**KEES INCORPORATED**  
 400 S. Industrial Dr. • P.O. Box L  
 Elkhart Lake, WI 53020  
 Phone: (920) 876-3391  
 Fax: (920) 876-3065  
 Website: www.kees.com